



Most Widely Accepted and Trusted

ICC-ES Report

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

ESR-2281

Reissued 12/2015
This report is subject to renewal 12/2016.

DIVISION: 05 00 00—METALS

SECTION: 05 40 00—COLD-FORMED METAL FRAMING

SECTION: 05 41 00—STRUCTURAL METAL STUD FRAMING

DIVISION: 09 00 00—FINISHES

SECTION: 09 22 16.13—NON-STRUCTURAL METAL STUD FRAMING

REPORT HOLDER:

TELLING INDUSTRIES

6272 CENTER STREET
MENTOR, OHIO 44060

EVALUATION SUBJECT:

METAL FRAMING



Look for the trusted marks of Conformity!

"2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence"



A Subsidiary of



ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.

ICC-ES Evaluation Report

ESR-2281

Reissued December 2015

This report is subject to renewal December 2016.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 05 00 00—METALS**Section: 05 40 00—Cold-Formed Metal Framing**
Section: 05 41 00—Structural Metal Stud Framing**DIVISION: 09 00 00—FINISHES****Section: 09 22 16.13—Non-Structural Metal Stud
Framing****REPORT HOLDER:**

TELLING INDUSTRIES
6272 CENTER STREET
MENTOR, OHIO 44060
(440) 974-3370
www.tellingindustries.com

EVALUATION SUBJECT:**METAL FRAMING****1.0 EVALUATION SCOPE****Compliance with the following codes:**

- 2006 *International Building Code®* (IBC)
- 2006 *International Residential Code®* (IRC)

Property evaluated:

Structural

2.0 USES

Telling Industries metal framing is used for nonload-bearing interior walls, curtain walls, load-bearing walls, floor joists, ceiling joists and furring.

3.0 DESCRIPTION**3.1 General:**

The metal framing members described in this report are factory-formed from coils of steel at the facilities noted in Table 8. See Tables 1, 2, 5 and 6, and Figure 1, for recognized profiles and section names. The C-sections (studs) are manufactured with and without web punch-outs. When provided, punch-outs have a width between $\frac{3}{4}$ inch (19 mm) and $1\frac{1}{2}$ inches (38 mm) but in no case greater than one-half the member web height ($d/2$); and a length of 4 inches (102 mm). See Figure 3 for an illustration of punch-outs. The punch-outs are located along the centerline of the webs of the studs with a minimum center-to-center spacing of 24 inches (610 mm). The minimum distance between the end of the stud and the near edge of the web punch-outs is 10 inches (254 mm). The values for studs in each of the tables of

this report are for studs with punch-outs unless otherwise noted.

C-sections with 1.25-inch (32 mm) flanges may have indentations on the flanges. All other surfaces are flat, smooth surfaces. All surfaces of all other members are flat and smooth.

3.2 Materials:

Telling Industries metal framing members are cold-formed from steel coils conforming to ASTM A 1003 ST33H or ASTM A 1003 ST50H for members with a thickness of 33 mils or more, and ASTM A 1003 NS33 for members with a thickness of less than 33 mils [only for use as interior nonload-bearing framing members with a 5 psf (239 Pa) maximum transverse load]. The steel is hot-dipped galvanized with a minimum galvanization coating designation of G60 for all studs, except that the galvanization coating designation may be G40 for use as interior nonload-bearing framing members with a 5 psf (239 Pa) maximum transverse load. The base-metal thickness is specified in Tables 1 through 6.

4.0 DESIGN AND INSTALLATION**4.1 Design:**

The section properties indicated in Tables 3 through 6 have been determined in accordance with the 2001 edition of the North American Specification for Design of Cold-formed Steel Structural Members, including 2004 Supplement (AISI-NAS). The allowable moments, M_a , as indicated in Tables 3 through 6, are for use with Allowable Strength Design (ASD), and are for flexural members installed with the compression flange continuously braced. For other conditions of compression flange bracing, the allowable moment must be determined in accordance with AISI-NAS. The design of members must address web crippling, combined bending and web crippling, and combined bending and shear, as applicable, in accordance with the AISI-NAS.

C-sections (studs) listed in Table 7 and channels (tracks) qualify for use with the prescriptive requirements of the IRC. For use of all other sections under the IRC, the cold-formed steel framing members must be limited to engineered structures, in accordance with IRC Section R301.1.3.

4.2 Installation:

The framing members must be installed in accordance with the code, the approved plans and this report. If there is a conflict between the plans submitted for approval and this report, this report governs. The approved plans must be made available at the jobsite at all times.

5.0 CONDITIONS OF USE

The Telling Industries metal framing described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1** The cold-formed steel members are installed in accordance with the code, the approved plans and this report.
- 5.2** Minimum uncoated base-metal thickness of the cold-formed steel members as delivered to the jobsite are at least 95 percent of the design base-metal thickness noted in Tables 1, 2, 5 and 6.
- 5.3** Complete plans and calculations verifying compliance with this report must be submitted to the code official for each project at the time of permit application. The calculations and drawings must be prepared and sealed by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.

- 5.4** Studs and tracks having a galvanized coating weight of less than G60 must be limited to use as nonload-bearing interior wall framing subject to a maximum transverse load of 5 psf (239 Pa).

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Cold-formed Steel Framing Members (AC46), dated February 2007 (editorially revised April 2008).

7.0 IDENTIFICATION

At a spacing not exceeding 48 inches (1219 mm) on center, each cold-formed steel member is stamped with the Telling Industries name or initials (TI); the section name as described in Tables 1 through 6; the evaluation report number (ICC-ES ESR-2281); the minimum uncoated base-metal thickness in mils or decimal inches; the minimum specified yield strength [if greater than 33 ksi (228 MPa)]; and the galvanization coating designation (if G60 or greater).

TABLE 2—CHANNEL (TRACK) SECTIONS¹ (Continued)

SECTION	DEPTH ² (in)	FLANGE (in)	INSIDE CORNERS RADII (in)	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. ³ (in)	SECTION	DEPTH ² (in)	FLANGE (in)	INSIDE CORNERS RADII (in)	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. ³ (in)
1150T300-54 ⁴	11.500	3.000	0.0849	54	0.0566	0.0538	1350T200-54 ⁴	13.500	2.000	0.0849	54	0.0566	0.0538
1150T300-68	11.500	3.000	0.1069	68	0.0713	0.0677	1350T200-68	13.500	2.000	0.1069	68	0.0713	0.0677
1150T300-97	11.500	3.000	0.1525	97	0.1017	0.0966	1350T200-97	13.500	2.000	0.1525	97	0.1017	0.0966
1150T300-118	11.500	3.000	0.1863	118	0.1242	0.1180	1350T200-118	13.500	2.000	0.1863	118	0.1242	0.1180
1150T400-68	11.500	4.000	0.1069	68	0.0713	0.0677	1350T250-54 ⁴	13.500	2.500	0.0849	54	0.0566	0.0538
1150T400-97	11.500	4.000	0.1525	97	0.1017	0.0966	1350T250-68	13.500	2.500	0.1069	68	0.0713	0.0677
1150T400-118	11.500	4.000	0.1863	118	0.1242	0.1180	1350T250-97	13.500	2.500	0.1525	97	0.1017	0.0966
1200T125-54 ⁴	12.000	1.250	0.0849	54	0.0566	0.0538	1350T250-118	13.500	2.500	0.1863	118	0.1242	0.1180
1200T125-68	12.000	1.250	0.1069	68	0.0713	0.0677	1350T300-54 ⁴	13.500	3.000	0.0849	54	0.0566	0.0538
1200T125-97	12.000	1.250	0.1525	97	0.1017	0.0966	1350T300-68	13.500	3.000	0.1069	68	0.0713	0.0677
1200T125-118	12.000	1.250	0.1863	118	0.1242	0.1180	1350T300-97	13.500	3.000	0.1525	97	0.1017	0.0966
1200T150-54 ⁴	12.000	1.500	0.0849	54	0.0566	0.0538	1350T300-118	13.500	3.000	0.1863	118	0.1242	0.1180
1200T150-68	12.000	1.500	0.1069	68	0.0713	0.0677	1350T400-68	13.500	4.000	0.1069	68	0.0713	0.0677
1200T150-97	12.000	1.500	0.1525	97	0.1017	0.0966	1350T400-97	13.500	4.000	0.1525	97	0.1017	0.0966
1200T150-118	12.000	1.500	0.1863	118	0.1242	0.1180	1350T400-118	13.500	4.000	0.1863	118	0.1242	0.1180
1200T200-54 ⁴	12.000	2.000	0.0849	54	0.0566	0.0538	1400T125-54 ⁴	14.000	1.250	0.0849	54	0.0566	0.0538
1200T200-68	12.000	2.000	0.1069	68	0.0713	0.0677	1400T125-68	14.000	1.250	0.1069	68	0.0713	0.0677
1200T200-97	12.000	2.000	0.1525	97	0.1017	0.0966	1400T125-97	14.000	1.250	0.1525	97	0.1017	0.0966
1200T200-118	12.000	2.000	0.1863	118	0.1242	0.1180	1400T125-118	14.000	1.250	0.1863	118	0.1242	0.1180
1200T250-54 ⁴	12.000	2.500	0.0849	54	0.0566	0.0538	1400T150-54 ⁴	14.000	1.500	0.0849	54	0.0566	0.0538
1200T250-68	12.000	2.500	0.1069	68	0.0713	0.0677	1400T150-68	14.000	1.500	0.1069	68	0.0713	0.0677
1200T250-97	12.000	2.500	0.1525	97	0.1017	0.0966	1400T150-97	14.000	1.500	0.1525	97	0.1017	0.0966
1200T250-118	12.000	2.500	0.1863	118	0.1242	0.1180	1400T150-118	14.000	1.500	0.1863	118	0.1242	0.1180
1200T300-54 ⁴	12.000	3.000	0.0849	54	0.0566	0.0538	1400T200-54 ⁴	14.000	2.000	0.0849	54	0.0566	0.0538
1200T300-68	12.000	3.000	0.1069	68	0.0713	0.0677	1400T200-68	14.000	2.000	0.1069	68	0.0713	0.0677
1200T300-97	12.000	3.000	0.1525	97	0.1017	0.0966	1400T200-97	14.000	2.000	0.1525	97	0.1017	0.0966
1200T300-118	12.000	3.000	0.1863	118	0.1242	0.1180	1400T200-118	14.000	2.000	0.1863	118	0.1242	0.1180
1200T400-68	12.000	4.000	0.1069	68	0.0713	0.0677	1400T250-54 ⁴	14.000	2.500	0.0849	54	0.0566	0.0538
1200T400-97	12.000	4.000	0.1525	97	0.1017	0.0966	1400T250-68	14.000	2.500	0.1069	68	0.0713	0.0677
1200T400-118	12.000	4.000	0.1863	118	0.1242	0.1180	1400T250-97	14.000	2.500	0.1525	97	0.1017	0.0966
1350T125-54 ⁴	13.500	1.250	0.0849	54	0.0566	0.0538	1400T250-118	14.000	2.500	0.1863	118	0.1242	0.1180
1350T125-68	13.500	1.250	0.1069	68	0.0713	0.0677	1400T300-54 ⁴	14.000	3.000	0.0849	54	0.0566	0.0538
1350T125-97	13.500	1.250	0.1525	97	0.1017	0.0966	1400T300-68	14.000	3.000	0.1069	68	0.0713	0.0677
1350T125-118	13.500	1.250	0.1863	118	0.1242	0.1180	1400T300-97	14.000	3.000	0.1525	97	0.1017	0.0966
1350T150-54 ⁴	13.500	1.500	0.0849	54	0.0566	0.0538	1400T300-118	14.000	3.000	0.1863	118	0.1242	0.1180
1350T150-68	13.500	1.500	0.1069	68	0.0713	0.0677	1400T400-68	14.000	4.000	0.1069	68	0.0713	0.0677
1350T150-97	13.500	1.500	0.1525	97	0.1017	0.0966	1400T400-97	14.000	4.000	0.1525	97	0.1017	0.0966
1350T150-118	13.500	1.500	0.1863	118	0.1242	0.1180	1400T400-118	14.000	4.000	0.1863	118	0.1242	0.1180

For SI: 1 inch = 25.4 mm.

¹ See Table 4 for member properties. See Figure 1 for illustration of member cross section.² Depth measured from inside face to inside face of flanges.³ Base metal thickness of members, exclusive of coatings, delivered to the jobsite must be a minimum of 95 percent of design the thickness.⁴ Web height-to-thickness ratio, h/t, exceeds 200. Web stiffeners in accordance with Sections B1.2 and C3.6.1 of AISI-NAS are required.

TABLE 5—U CHANNELS STRUCTURAL PROPERTIES^{1,2}

SECTION ⁵	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. (in)	INSIDE CORNER RADII (in)	WEIGHT (lb/ft)	GROSS SECTION PROPERTIES ³					EFFECTIVE SECTION PROPERTIES			ALLOWABLE MOMENT ⁴ M _a (in-k)
						Area (in ²)	I _x (in ⁴)	r _x (in)	I _y (in ⁴)	r _y (in)	I _x (in ⁴)	S _x (in ³)	Area (in ²)	
75U050-54	54	0.0566	0.0538	0.0849	0.30	0.087	0.007	0.288	0.002	0.155	0.007	0.019	0.087	0.45
150U050-54	54	0.0566	0.0538	0.0849	0.44	0.129	0.039	0.547	0.003	0.144	0.039	0.052	0.129	1.22
200U050-54	54	0.0566	0.0538	0.0849	0.54	0.157	0.079	0.709	0.003	0.136	0.079	0.079	0.157	1.87
250U050-54	54	0.0566	0.0538	0.0849	0.63	0.186	0.139	0.866	0.003	0.128	0.139	0.111	0.186	2.64

For SI: 1 inch = 25.4 mm, 1 lb/ft = 1.488 kg/m, 1 in-lb = 11.30 N-m.

I_x = Strong axis moment of inertia. r_y = Weak axis radius of gyration.

r_x = Strong axis radius of gyration. S_x = Strong axis section modulus.

I_y = Weak axis moment of inertia.

¹F_y = 33 ksi.

²Use the effective moment of inertia for deflection calculations.

³Gross properties are based on the full-unreduced cross section of the U channel.

⁴Full lateral support of compression flanges must be provided.

⁵Depth of member is measured from outside face to outside face of flanges. See Figure 1.

TABLE 6—HAT FURRING CHANNEL PROPERTIES^{1,3}

SECTION	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. (in)	INSIDE CORNER RADII (in)	WEIGHT (lb/ft)	DEPTH (in)	GROSS SECTION PROPERTIES					EFFECTIVE SECTION PROPERTIES		ALLOWABLE MOMENT ² M _a (ft-lb)
							Area (in ²)	I _x (in ⁴)	r _x (in)	I _y (in ⁴)	r _y (in)	I _x (in ⁴)	S _x (in ³)	
087F125-18	18	0.0188	0.0179	0.0843	0.239	0.875	0.0702	0.0089	0.356	0.0354	0.710	0.0086	0.0160	26.41
087F125-30	30	0.0312	0.0296	0.0784	0.391	0.875	0.1149	0.0143	0.353	0.0580	0.710	0.0143	0.0365	50.47
150F125-18	18	0.0188	0.0179	0.0843	0.320	1.500	0.0939	0.0311	0.575	0.0467	0.705	0.0299	0.0344	56.59
150F125-30	30	0.0312	0.0296	0.0784	0.525	1.500	0.1543	0.0503	0.571	0.0797	0.705	0.0503	0.0639	105.25

For SI: 1 inch = 25.4 mm, 1 lb/ft = 1.488 kg/m, 1 in-lb = 11.30 N-m.

I_x = Strong axis moment of inertia.

r_x = Strong axis radius of gyration.

I_y = Weak axis moment of inertia.

r_y = Weak axis radius of gyration.

S_x = Strong axis section modulus.

¹F_y = 33 ksi.

²Allowable moment is applicable for both positive and negative moments. Full lateral support of compression flanges must be provided.

³Use the effective moment of inertia for deflection calculations.

TABLE 7—C-SECTIONS (STUDS) FOR USE WITH THE IRC

IRC MEMBER DESIGNATION		EQUIVALENT TELLING INDUSTRIES MEMBER DESIGNATION							
		t = 33		t = 43		t = 54		t = 68	
350S162-t		350S162-33		350S162-43		350S162-54		350S162-68	
		350S200-33		350S200-43		350S200-54		350S200-68	
550S162-t		550S162-33		550S162-43		550S162-54		550S162-68	
		550S200-33		550S200-43		550S200-54		550S200-68	
800S162-t		800S162-33		800S162-43		800S162-54		800S162-68	
		800S200-33		800S200-43		800S200-54		800S200-68	
1000S162-t		---		1000S162-43		1000S162-54		1000S162-68	
		---		1000S200-43		1000S200-54		1000S200-68	
1200S162-t		---		---		1200S162-54		1200S162-68	
		---		---		1200S200-54		1200S200-68	

TABLE 8—MANUFACTURING LOCATIONS

Telling Industries Kingman, Arizona 86409 928-681-8409	Telling Industries Osceola, Arkansas 72370 870-563-2597
Telling Industries Cambridge, Ohio 43725 740-435-8900	

SECTION PROFILES

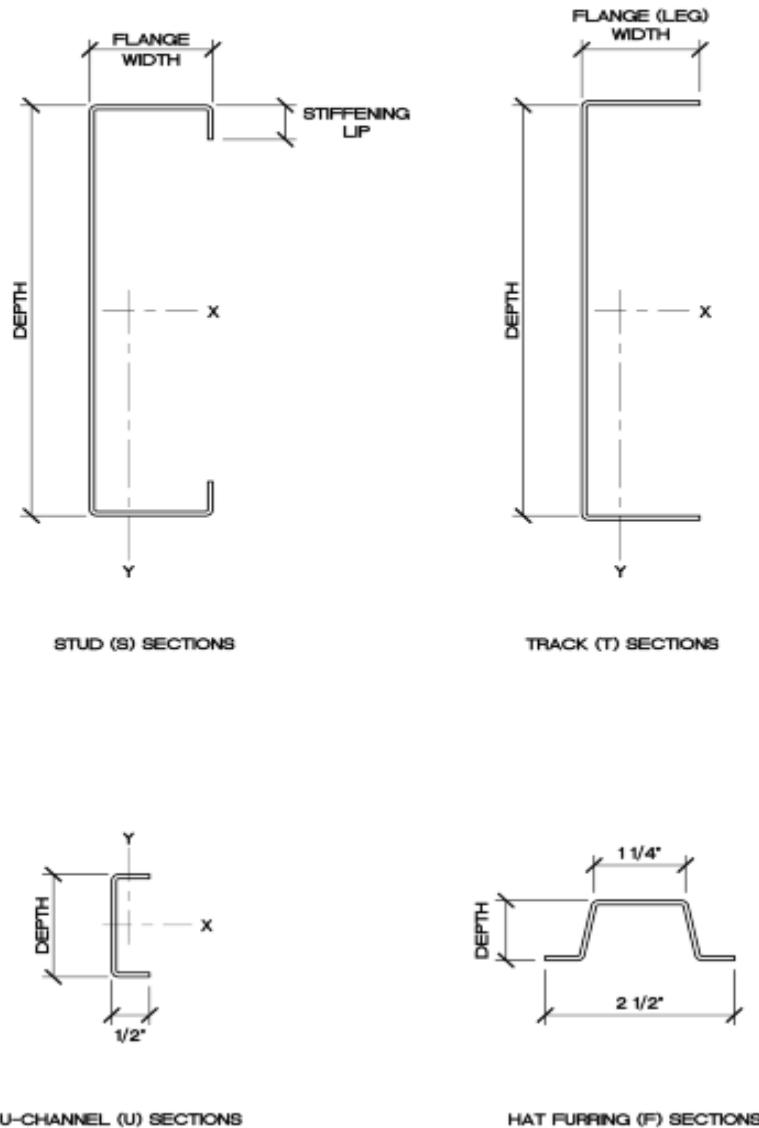


FIGURE 1—SECTION PROFILES


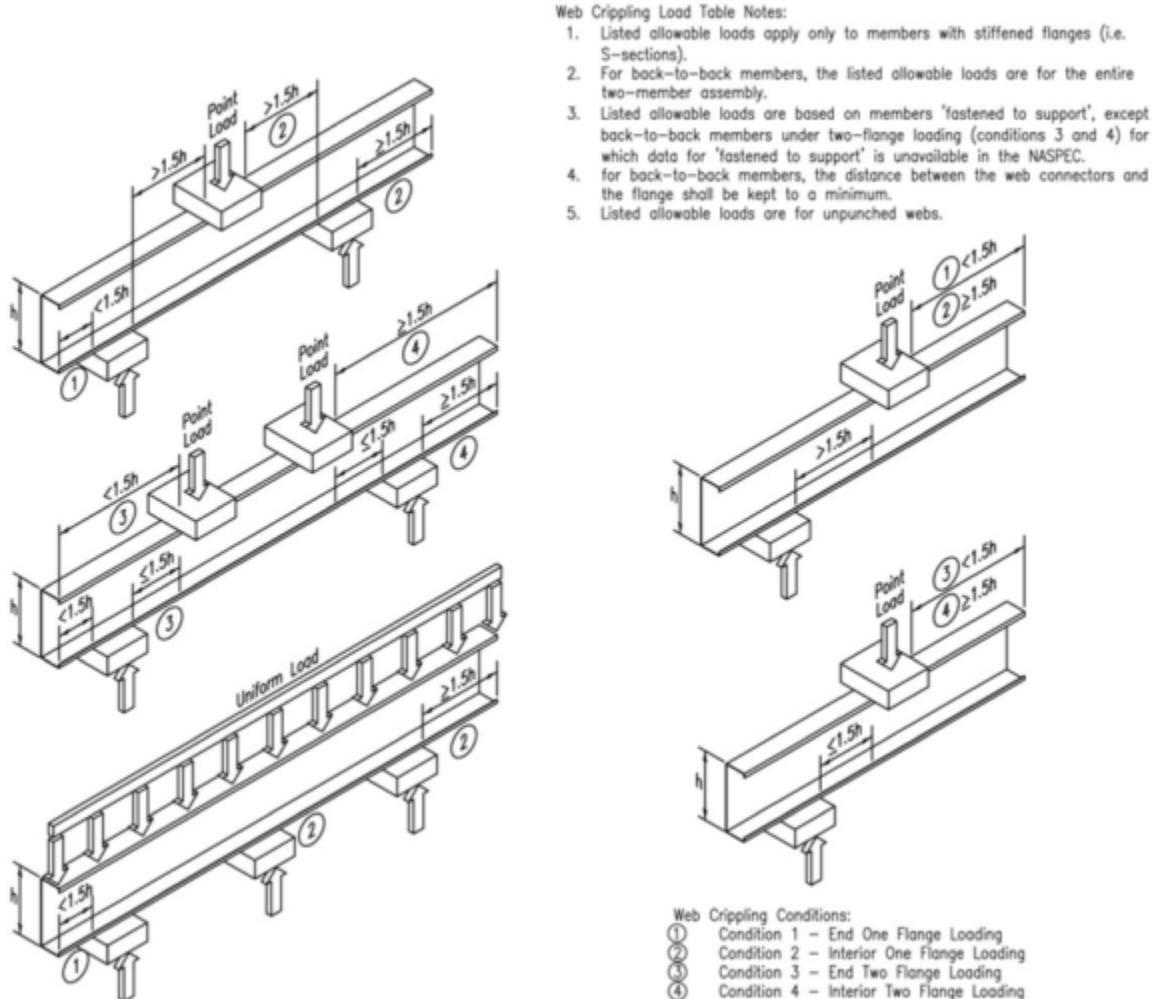


FIGURE 2—WEB CRIPPLING LOADING CONDITIONS

NON-LOAD BEARING KNOCKOUT SIZES

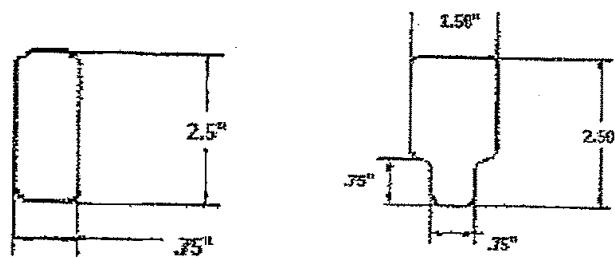

LOAD BEARING KNOCKOUT SIZES

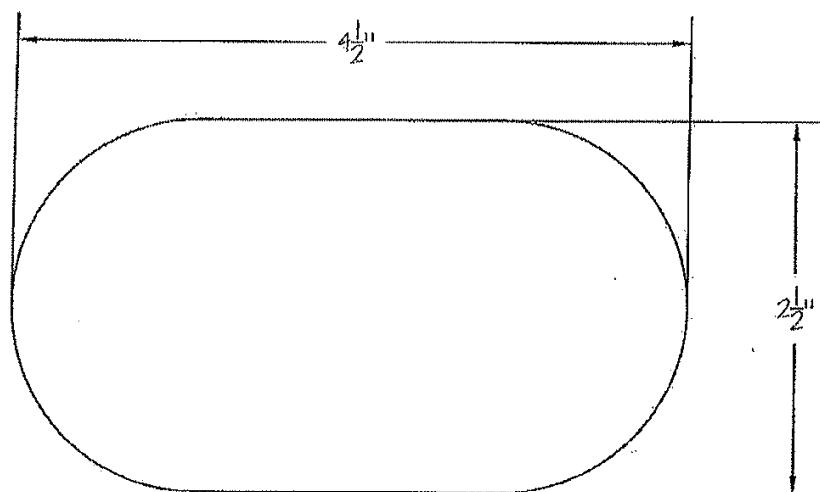
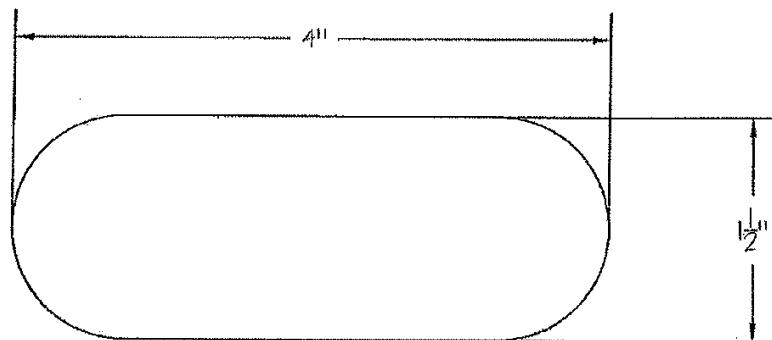
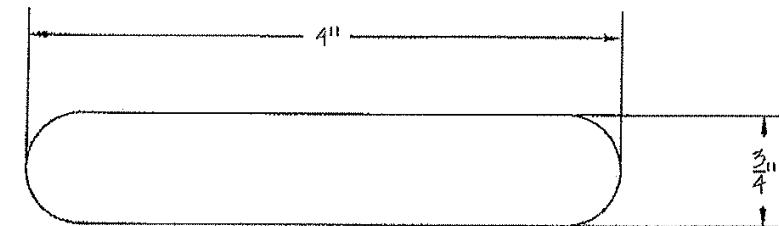


FIGURE 3—PUNCHOUTS